# flow~mon

...simple flow solutions in a complicated world

# Wafer Series Technical Specifications

## Function;

A scaled dial and mechanical indicator continuously monitor the flow rate at any given time whilst electrical switches can be specified to signal when a particular level has been reached during increasing or decreasing flow rates.

## Style;

Through its unique modular design it allows for easy field installation and service. It does not require any straight pipe runs before or after the monitor thus minimizing the installation footprint. The versatile design of the vane monitor allows for orientation to be mounted in any position. Vane style monitor operates when flow is introduced through the inlet connection making direct contact with the vane that is mechanically linked to the indicator shaft, the fluid forces the vane to open. The vane style monitor is spring loaded and allows the vane to return on decreasing flows.

## Switches;

Are field adjustable, suitable for batching, trending, totalising or recording where required. All Flow-Mon units can be supplied with a 0-10v or 4-20mA output.

## Sizes;

All sizes are manufactured to the same simple design concept, the main characteristic of which ensures that the pressure drops are confined to an absolute minimum across the vane orifice at full flow, with viscosities as high as 600cS. Sizes are defined by pipe size and/or maximum flow capacity, and every flow switch is individually calibrated so that full scale deflection is used in each application i.e. the maximum scale reading coincides with the maximum requirements of system as specified by the customer. Calibration may be in any units with Single or Dual scale to specification.

## Applications;

Water Soluble Oils (Glycols) Synthetic Based Fluids Corrosive Fluids Solvents De-Ionised Water Petroleum Based Fluids Coolants Paints Air & Gases

Minimum Scale;

## LPM 0-40 LPM


## Comparison;

Comparable to similar style devices in the industry, Flow–Mon's "flow through" design offers a low pressure loss. To ensure accuracy they are individually calibrated in any unit of measure to customer operating specifications.



## Dimensions;

DN	Α	С	Ansi	Α	С
80	138	216	3	127	210
100	158	226	4	157	217
150	218	264	6	216	263
200	278	291	8	270	287
250	335	318	10	324	313
300	395	348	12	381	338



### Features;

- Direct reading Flow Rate Indication
- Optional (field adjustable) switch(es)
- Optional Non-Contact 4-20mA Output
- High Pressure available
- · Mounts easily between Ansi, Jis or Din flanges
- Mounts in any orientation
- No straight Pipe Run required
- Connection sizes from 3" to 12"

		FML300	В	LP	3EE	10	cS	24W10	S3	D1	]
		<u> </u> ↓	·	·					<u> </u>	•	1
	FMS* FML* FMB* FMG* FMM*	AND FLOW RATE = Litres/Sec = Litres / Min = Imp. Gallons / Mir = U.S. Gallons / Mir = M3/ Hour II Flow Rate in Units								8 = ↑ □	DNS 22 = ← 04 = ↓
	MATERIA AL B CI CIK S SS	AL OF MANUFACTUF = Aluminum = Bronze = Cast Iron = Cast Iron Nickel PI = Carbon Steel = Stainless Steel							S1 = Buna S2 = EPDM S3 = Viton S4 = PTFE S5 = Perlast	(-40°C (-40°C (-20°C (-100°C (-15°C	+110°C) +150°C) +200°C) +250°C) +330°C)
	PTFE PVC	= PTFE = PVC						WAFER C	ONNECTIONS		
		r materials and pressu onsult factory.	res not specifie	ed, ▼				24 = 3" 32 = 4" 48 = 6" 64 = 8"	Wafer Bod	8". Standard ur ies - add releva own below).	
	PRESSU LP MP HP	<b>JRE RATING</b> = 300 psi / 20 bar m = 750 psi / 50 bar m = 3000 psi / 200 bar	aximum		<b>I</b>			For Flang following	/ led Connection codes:	is add one of	the
	INDICAT ME 3EE 4EE 6EE 3EEG 3EE(ATE	= SPDT 3 = SPDT D = DPDT 6 = SPDT 3	cal Pointer only Wire Switch ouble-break 4 v Wire switch Wire Switch wi kplosion Proof	wire switch th Gold Conta		3		W10 W16 W25 W40 W150	Alternative P in BS4504 / [ Alternative P	DIN2632-5	
	3EE(ATE 6EE(ATE AIR POT OUT TOT	X2) = SPDT E: X2) = DPDT E: = Pneuma = Potention = 4-20 mA	kplosion Proof kplosion Proof	Switch to ATE Switch to ATE	X zone 2			W300 W600 WAD WE	in BS1560 / A	ANSI B16.5	
	TOTX Note 1:	= Digital R All electrical boxes (a	ate Totaliser (A	,	o carry a			WF /	in BS10		
	Note 2: Note 3:	Mechanical Pointer For 4 & 6 Wire Switc Manufactured to IP6						For special at factory.	al wafer conne	ctions, please	e enquire
		CODE: 3E Basic sing 15 Amp - 1	le pole, double 25, 250 or 480 125V.DC / 0.25	throw, 3 wire V.AC			-	State units a eg. Water is	<b>AT OPERATIN</b> and scale and scale (classified of the state of the stat	S)	RE
e		10 Amp - 1 0.3 Amp - CODE: 6E Double-po and break 10 Amp - 1	rangements is 25 or 250V.AC 125V.DC / 0.15 E le, double throw two independe 25 or 250V.AC 125V.DC / 0.15	Amp - 250V. w switches sir nt circuits.	DC nultaneously m	nake		Flow-Mon fl gas flows in flows. Whe	as Application switches of the same sector of the s	an be used to ame way as li such an appl	quid lication
	explosive signal fro	IR em offers an alternativ e atmospheres. Compr m the danger area, or	ve safety arrang ressed air can to operate a k	gement for op be used to tra laxon inside tl	eration in nsmit an on / o ne danger area	a.		Maximum f	avity of the gas low volume cemperature pressure	1	
	2K etc.	OUT	to the notestic	motor to aive	the required 4	20					

A transducer can be connected to the potentiometer to give the required 4-20 mAmp readout. Data Loggers or Recorders can be added to the system.

The 3 and 6 wire switches described above are available in ATEX approved explosion proof versions, with the appropriate enclosure box. When two or more switches are assembled in one unit, they remain independently adjustable. Re-adjustments may be carried out in the field.

# Wafer Series

## Installation and Maintenance Instructions

## Installation Instructions;

The flow indicators are in-line devices. Mounting can be in any position, and no straight length of pipe is required before or after the unit. The unit is sandwiched between two flanges. Under the Pressure Equipment Directive (PED) these products are Pressure Accessories, and are not approved for use as safety Accessories, as defined by the PED. If used for safety purposes, it is the responsibility of the user/installer to assess the suitability of the product in the pressure equipment or system in which it is used.

# It is the responsibility of the user/installer of this equipment to ensure;-

- 1. The product is installed and used by suitably trained personnel in accordance with all relevant Local and National regulations and codes.
- Safe working practices for the media & processes concerned are followed during installation & maintenance.
- 3. The materials of construction are suitable for the application.
- 4. The product is protected from fire.
- 5. The product is protected from impact/vibration.
- 6. The instrument is only cleaned by washing with detergent, do not use abrasive cleaners or solvents.
- 7. For outdoor use in exposed positions the instrument must be additionally protected/shielded from heavy rainfall.
- 8. Regular inspection for corrosion/erosion and wear are carried out.

## **Essential Safety Requirements;**

- 1. The instrument must be installed in accordance with the instructions provided.
- 2. Prior to installation ensure pipelines are flushed/drained to ensure they are free from any solid particles or pressure.
- Care must be taken to avoid introducing torsional stress on the instrument when installing into the pipeline. Tighten sufficiently to avoid leaks & check at regular intervals during maintenance.
- 4. Ensure pipelines are fully primed before commencing normal use.
- 5. Valves must be opened or closed gradually to avoid shock/vibration.
- 6. Do not exceed maximum working pressure as stated on the label.
- 7. Only use with the fluid/gas stated on the label.
- 8. Do not exceed minimum/maximum working temperature as stated.
- 9. Do Not Use instrument if any part of the cable appears to be damaged.
- 10.Isolate instrument before removing cover.

## **General Maintenance;**

- 1. Remove instrument from pipeline.
- Remove from flanges (keep enclosure box and spring housing intact)
- 3. Check for and remove any swarf/foreign body, clean if necessary.
- 4. Remove faceplate and window
- 5. Check pointer is still firmly secured
- 6. Push open the valve plate, (depending on flow rate tension may be high), the valve plate will spring back to 0 when released. Repeat a few times at different points along the scale.
- Listen/watch the switch to make sure it is activated at desired min/max flow as the valve plate is pushed open. (Adjust cam if necessary)
- DO NOT remove or adjust springs as this will affect the calibration of the instrument.
  Re-assemble instrument.

## Switch Setting;

The cam which operates the microswitch is situated on the spindle behind the pointer and can be adjusted to give an alarm anywhere between zero and max, flow. To alter the setting, lift the cam and rotate the cam in the direction required until switch point is located, then gently lower cam in that position.

# Enclosure box rotation instructions-change of flow direction

Tools required: Screw driver, Allen wrench set , 5/16 nut driver

- 1.)Remove 4 screws from nameplate. -5/16 Nut Driver
- 2.)Remove Name Plate and Window
- 3.)Remove Calibrated Scale.
- 4.)Remove Electrical Switch -Screw Driver (if monitor does not have switch(es) go to #5.)
- 5.)Remove all 4 Allen Screws (5/32 or 4mm Allen Wrench) at base of enclosure and rotate enclosure box to the desired position
- 6.)Place 4 Allen Screws back into required tapped and tighten control box to meter body.
- 7.)Loosen Indicator Pointer

NOTE: if monitor does not have switch(es) skip to #11)

- 8.)"Slightly" Loosen Cam Set Screw just enough to move cam on dial. (DO NOT LOOSEN DIAL SET SCREW LOCATED BELOW THE CAM). This will make easier to tighten once switch contact point is set.) -1/8 (3.175mm)Allen Wrench
- 9.)Place Switch back into enclosure box and tighten until snug DO NOT OVER TIGHTEN

NOTE: Switch should be wired prior to re-installation

10.)Rotate Cam to desired Set Point and tighten Allen Screw/Replace Compression Spring until snug. Cam will press against switch roller arm to actuate switch.

11.)Place Calibrate Scale and tighten back in position.

### - DO NOT OVER TIGHTEN

- 12.)Move Pointer to zero position on calibrated scale and tighten
- 13.)Place Window then nameplate back on enclosure box and tighten Allen Screws.

### Estimated time to rotate control box: 10 to 15 minutes.

## Troubleshooting;


- In the event of a pointer appearing to stick in one position, remove centre housing and clean away pipe scale to ensure that valve plate is free to return to its seating position. (A spacer can be provided so that the flow can pass through whilst maintenance is being carried out)
- 2. If the pointer 'trembles' allow flow to continue. 'Trembling' is usually air entrapment, and this will be eliminated when the system becomes full.
- 3. At regular intervals the control valve to the circuit should be closed for one second and then opened to ensure that no large foreign body is holding the vane in one position. The indicator should drop to zero when closing the valve, and then when the valve is opened again return to the running flow point. When carrying out the procedure in 3. the indicator will immediately return to a position a little less than the running flow position and slowly return to the correct reading. This is due to the hysteresis of the 'O' rings and spring.


# Wafer Series Spares Data

When ordering spares, please give reference number followed by quantity required.

All orders should be accompanied by a model number and a serial number of the Flow switch!

Item No.	Part No.	Qty.
1.	Wafer Body	1
2.	Wafer Al Neck	1
3.	Indicator Rod	1
4.	Indicator Rod - Boss	1
5.	Indicator Rod - Peg	1
6.	Valve Plate	1
7.	Indicator Rod - Bearing	1
8.	Collar	1
9.	Collar - Peg	1
10.	Pointer Boss	1
11.	Pointer	1
12.	Indicator Housing	1
13.	Indicator Plate	1
14.	Medium Spring Housing	1
15.	Spirol Spring	1

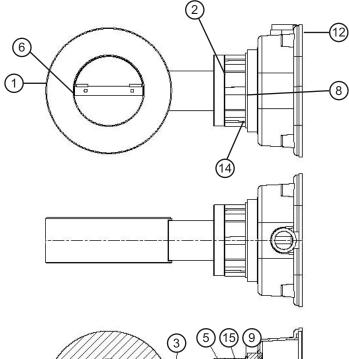









For further information contact: Tel: 01423 561972 Fax: 01423 502063 Email: sales@flow-mon.com www.flow-mon.com Flow-Mon Limited, Chatworth House, Chatsworth Terrace, Harrogate, North Yorkshire HG1 5HT, UK





Wafer General Assembly