

ISOMAG ™

The friendly magmeter

FAST SAMPLING CONVERTER

ML4-F1



**HIGH SAMPLING RATE CONVERTER
(UP TO 400 SAMPLES/SECOND)**

Warranty conditions are available on this website:
www.isomag.eu only in English version

ISOIL 
INDUSTRIA
The solutions that count

INDEX

TECHNICAL DATA.....	3
OVERALL FEATURES.....	3
STANDARD FEATURES.....	3
OPTIONAL FEATURES.....	4
ACCURACY.....	4
OVERALL DIMENSIONS.....	5
VISUALIZATION PAGES.....	6
ELECTRICAL CONNECTIONS.....	7
FUNCTIONS.....	9
ACCURACY TABLE.....	11
HOW TO ORDER.....	12

TECHNICAL DATA





<i>OVERALL FEATURES</i>	
Suitable For	<input type="checkbox"/> All the ISOMAG sensors
Minimum conductivity	<input type="checkbox"/> 5 μS/cm
Altitude	<input type="checkbox"/> -200 m up to 2000 m
Ambient Temperature	<input type="checkbox"/> -20... +60°C / -4... +140 °F (max 40°C 104°F with liquid > 60 °C 140°F)
Liquid temperature	<input type="checkbox"/> Max 100°C 212°F (130°C 266°F for 30 min ; no time limits if converter off)
Humidity Range	<input type="checkbox"/> 0÷100% (IP 67)

<i>STANDARD FEATURES</i>	
Housing materials	<input type="checkbox"/> Stainless steel AISI 304
Protection Rate	<input type="checkbox"/> IP 67
Power Supply	<input type="checkbox"/> 18-30 V $\overline{\text{---}}$
Cable Gland	<input type="checkbox"/> N° 2 CABLE GLAND PG 9
Full scale value	<input type="checkbox"/> 0,4...10m/s
Protocols	<input type="checkbox"/> ETP
Galvanic Isolation	<input type="checkbox"/> All the inputs/outputs are galvanically isolated from power supply
Programming Plug In	<input type="checkbox"/> Protected plug in for connection to PC
Data Storage	<input type="checkbox"/> Eeprom stored measuring values on power failure
Bi-Directional	<input type="checkbox"/> Yes
Diagnostic Funct.	<input type="checkbox"/> Yes
Empty Pipe Detect.	<input type="checkbox"/> Yes
Batch Function	<input type="checkbox"/> Yes, also with auto-preset
CE Certification	<input type="checkbox"/> Yes


OPTIONAL FEATURES (CHECK HOW TO ORDER, AT LAST PAGE, FOR MORE DETAILS)	
Power Supply	<input type="checkbox"/> 20-30 V $\overline{\text{---}}$ with 4/20 mA
Pulses/ Alarm Outputs	<input type="checkbox"/> N°2 , 1250 Hz, 100mA, 40 V $\overline{\text{---}}$
Digital Input/Outputs	<input type="checkbox"/> N° 5 O.C. freely Programmable function (as input or output, see pag. 5 for details)
Current Output	<input type="checkbox"/> (OPTIONAL) 4...20mA – RL 500 Ω passive (p.s. 20-30 VDC)
Communication interface	<input type="checkbox"/> RS485/PROFIBUS DP
Protocols	<input type="checkbox"/> ETP/Profibus DP

ACCURACY	
Measurement Tolerance	<input type="checkbox"/> Flow rate (volume) = $\pm 0,05\%$ r.v. <input type="checkbox"/> Out 4/20 mA = $\pm 0,5\%$ r.v. <input type="checkbox"/> Frequency Out = $\pm 0,08\%$ r.v.
Repeatability	<input type="checkbox"/> Better than 0,01%
Accuracy (whole system converter+sensor)	<input type="checkbox"/> See table below


OVERALL DIMENSIONS

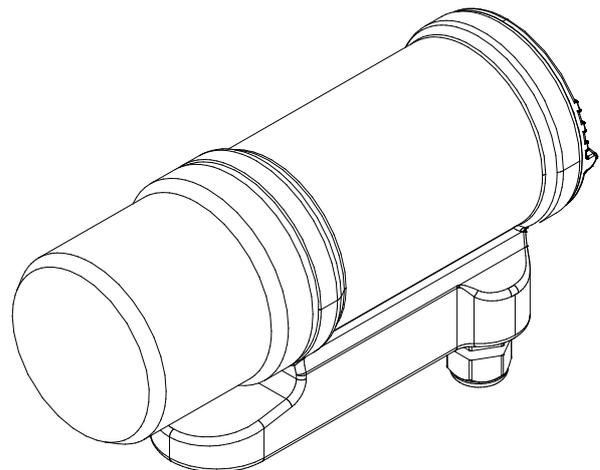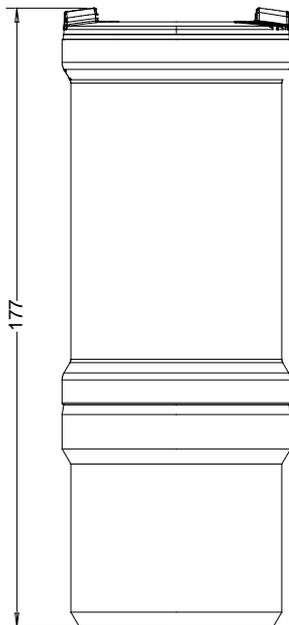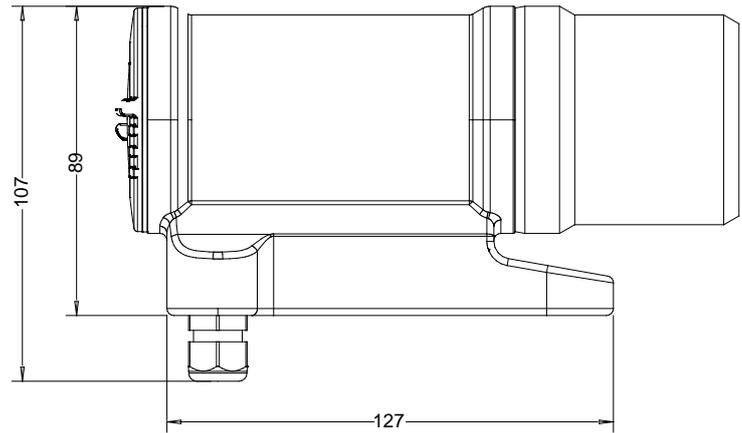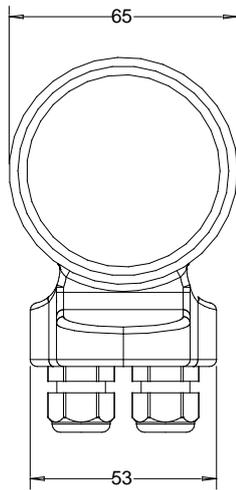

VISUALIZATION PAGES

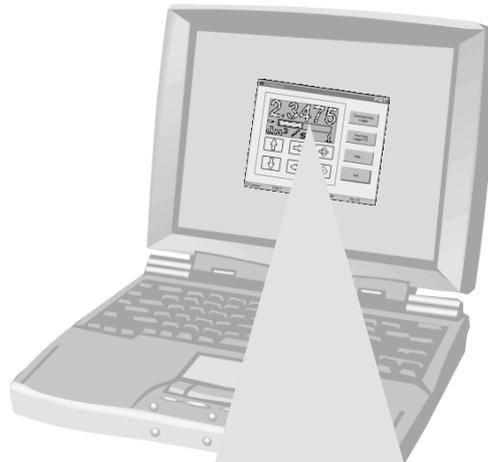


Flowrate and totalizers visualization



Flowrate, speed values and graph



Flowrate value and Full scale %




Flowrate graph




Flowrate value with currency function enabled

Different visualisation possibilities with the simple press of a key


ELECTRICAL CONNECTIONS

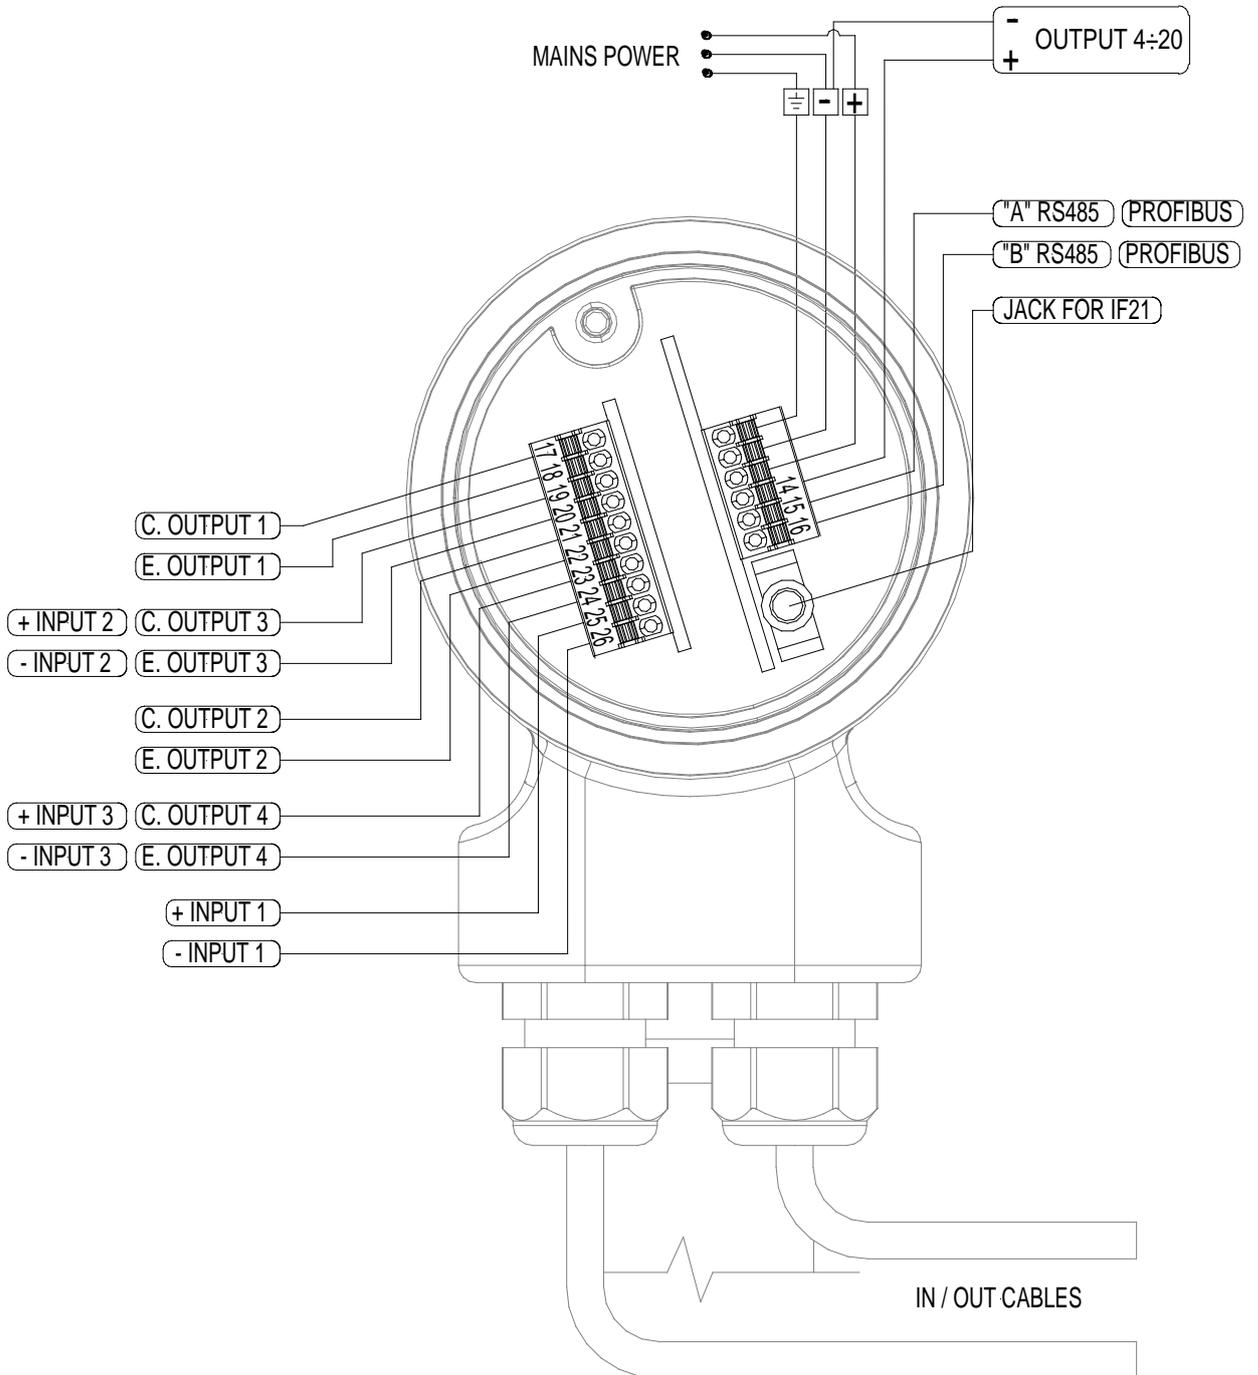


OUTPUT 1/2

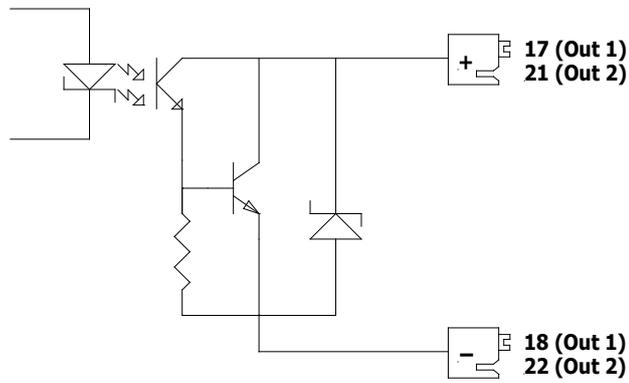

PROGRAMMABLE INPUT/OUTPUT

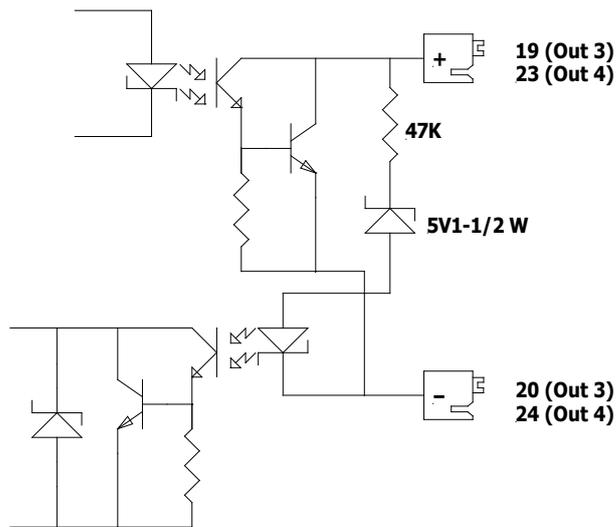

INPUT

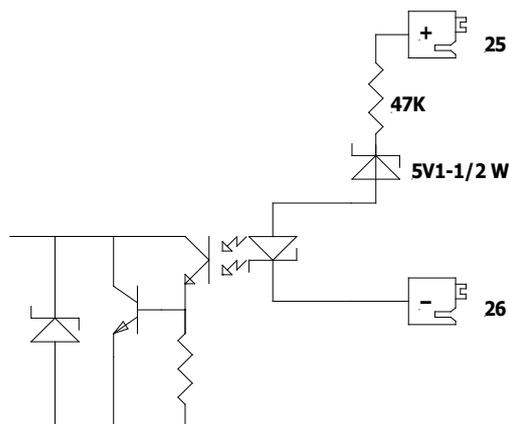

FUNCTIONS

```

MAIN MENU
1-Sensor
2-Scales
1-SENSOR
ND=mm 00025
KA=mm +01.0000
S.model= 014
Ki= 1.0000
Kp= 1.0000
E.p.detect= OFF
E.cleaning= OFF
E.p.thr.= 200
Autozero cal.
                
```

- 1.1 Insert the Nominal Diameter of the sensor (0-3000mm)
- 1.2 Calibration data of sensor visualized on sensor label
- 1.3 Sensor model: enter the first two characters of the sensor serial number
- 1.4 Factory parameters
- 1.5 Enables the empty pipe detection feature
- 1.6* Electrodes cleaning
- 1.7* Value of empty pipe sensibility detection
- 1.8* Enables the automatic zero calibration system

```

MAIN MENU
1-Sensor
2-Scales
2-SCALES
Fs1=dm³/s 5.0000
Fs2=dm³/s 8.1920
MlTot.=dm³ 1.000
Imp1=dm³ 1.00000
Imp2=dm³ 1.00000
Ipul1=ms 0050.00
Ipul2=ms 0050.00
Sg=kg/dm³ 01.0000
                
```

- 2.1* Full scale value set for range N.1
- 2.2* Full scale value set for range N.2
- 2.3* Unit of measure and number of decimal totalizes
- 2.4* Pulse value on output 1
- 2.5* Pulse value on output 2
- 2.6* Duration of the pulse generated on output 1
- 2.7* Duration of the pulse generated on output 2
- 2.8 Specific gravity set in kg/dm³ (enable only if FS1 or FS2 are weigh/time)

```

MAIN MENU
1-Sensor
2-Scales
3-Measure
3-MEASURE
Damping= OFF
Cut-off=% 10.0
Start thr=% 00.0
Autocal.= OFF
Autorange= OFF
                
```

- 3.2* Measure filter
- 3.1 Low flow zero threshold: 0-25% of full scale value
- 3.4 Only for service purposes
- 3.5 Enable every hour an internal cycle of calibration. The measure is stopped for 8-15 sec.
- 3.6* Automatic change of scale

```

MAIN MENU
1-Sensor
2-Scales
3-Measure
4-alarms
4-ALARMS
Max thr+=% 000
Max thr-=% 000
Min thr+=% 000
Min thr-=% 000
Hyst.=% 03
M.A.v.fault=% 000
Timeout=s 00.0
                
```

- 4.1 Maximum value alarm set for direct flow rate
- 4.2 Maximum value alarm set for reverse flow rate
- 4.3 Minimum value alarm set for direct flow rate
- 4.4 Minimum value alarm set for reverse flow rate
- 4.5 Hysteresis threshold set for the minimum and maximum flow rate alarms
- 4.6* Current output value in case of failure
- 4.7* Batch safety timer

```

MAIN MENU
1-Sensor
2-Scales
3-Measure
4-alarms
5-inputs
5-INPUTS
T1 reset= OFF
T2 reset= ON
Puls. reset= OFF
Count lock= OFF
Meas. lock= ON
Calibration= OFF
Range change= OFF
Batch= ON
Inp. 2= OFF
Inp. 3= OFF
                
```

- 5.1* Total direct (positive) flow totalizer reset enable
- 5.2* Partial direct (positive) flow totalizer reset enable
- 5.3 Reset totalizer of pulse from digital input (see page 13)
- 5.4 Totalizer counting lock command (see page 13)
- 5.5* Block measures command
- 5.6* Autozero calibration external command
- 5.7 Range change external command (see pos. 3.5)
- 5.8 Batch start/stop external command (see batch functions)
- 5.9* Functions assigned to input 2 (automatically disabled if OUT3 is enabled)
- 5.10* Functions assigned to input 3 (automatically disabled if OUT4 is enabled)

Functions assigned on input 1

```

1-Measure
2-alarms
3-Inputs
4-Outputs
5-Outputs
6-OUTPUTS
Out1= #1 IMP+
Out2= SIGN
Out3= OFF
Out4= #2 IMP+
Out1 mA=4:22
    
```

- 6.1* Output 1 functions
- 6.2* Output 2 functions
- 6.3* Output 2 functions
- 6.4* Output 4 functions
- 6.5* Choice of the function and the range of current output n.1

```

6-Outputs
7-COMMUNICATION
IF2 pr.= DPP
Address= 000
Speed= 38400
A.delay=ms @
    
```

- 7.1 Choice of the communication protocol for the IF2 device
- 7.2 Address value of the converter
- 7.3 Speed of the RS485 output (possible choices: 4800, 9600, 19200, 38400 bps)
- 7.4 Instrument answer delay

```

6-Outputs
7-Communication
8-DISPLAY
Language= EN
Totaliz.= T+/T-
D.rate=Hz 10
Quick start= OFF
T1 reset
T2 reset
    
```

- 8.1 Choice of the language: EN= English, IT=italian, FR= French, SP= Spanish
- 8.2 Display totalizer mode
- 8.3 Updating frequency on the display: 1-2-5-10 Hz
- 8.4 Quick start menu visualization
- 8.5* Volume totalizer 1 reset
- 8.6* Volume totalizer 2 reset

Menu 9 visualized only IF batch is active

```

9-BATCH
N.samples= 000
Hyst.=% 010
U.com.dm= 00.000
U.pre.dm= 00.000
Auto batch= OFF
BM auto sel= OFF
Cons.mode= OFF
8-Display
9-BATCH
10-Diagnostic
11-Internal data
    
```

- 9.1* Number of batch cycles to be done to define the value of compensation.
- 9.2* % limit of compensation threshold
- 9.3* Compensation value
- 9.4* Prebatch value
- 9.5* Auto-batch
- 9.6* Automatic selection of batch formula
- 9.7* Static consent of batch

```

MAIN MENU
10-DIAGNOSTIC
Calibration
Self test
Simulation= OFF
STAND-BY
Firmware rev.
7-Communication
8-Display
9-Batch
10-Diagnostic
11-Internal data
    
```

- 10.1* Enable the calibration of the converter
- 10.2* Converter autotest
- 10.3* Flow rate simulation enabling
- 10.4 Stand-by of converter to reduce the consumption during service operation
- 10.5 Firmware revision/version


```

MAIN MENU
1-Sensor
11-INTERNAL DATA
L2 keycode=*****
Load fact.pres.
Load user pres.
Save user pres.
Ign.cal.err= OFF
KS= +1.0000
10-Diagnostic
11-Internal data
    
```

- 11.1 Level 2 access code enter
- 11.2 Load factory data pre-set
- 11.3 Load user data saved
- 11.4 Save user data
- 11.5 Ignore the calibration error during the switch on test
- 11.6 Ks coefficient (only for service purposes)

Note : all page number references are to the operating manual

ACCURACY TABLE

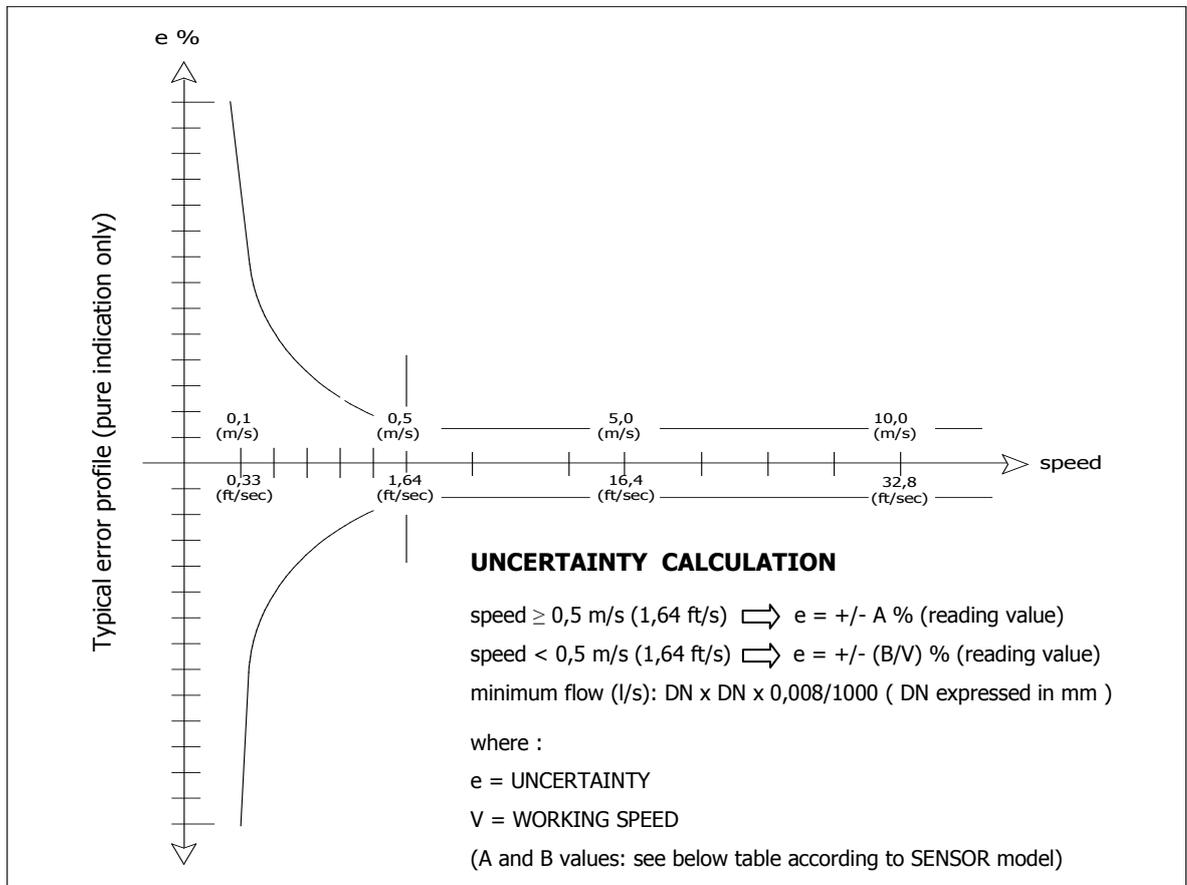

FULL BORE SENSORS

MS501/MS1000/MS2410/MS2500			MS 600			MS5000		
A	B(m/s)	B(ft/s)	A	B(m/s)	B(ft/s)	A	B(m/s)	B(ft/s)
0,2	0,1	0,33	0,4	0,2	0,66	2	1	3,28

INSERTION SENSORS

See MS 3770 / MS 3800 DATA SHEET

Reference conditions :

- Constant flow rate during the test
- Pressure: >30 Kpa
- Flow condition : fully developed flow profile
- Zero stability +/- 0,005 %

HOW TO ORDER

Display	
A	A Blind execution (without display and programming keys)
Housing material / Protection rate	
1	1 AISI304 Stainless Steel housing, protection rate IP67
Version	
A	A Compact version with sensor MS... Max LIQUID T=100°C - 212°F (130°C - 266°F for 30 min ; no time limits if converter off)
Analogue output	
0	0 Without Analogue output
	1 Analogue output 4...20/22 mA (passive)
Additional module	
A	A Without additional module
	B ME35 : Profibus DP
	C ME36 : RS485 serial interface module
	D ME35 : Profibus DP , complete with 2 connectors : 1 for Profibus connection and 1 for Power Supply + IN/OUT conn
	E M12 Male connector for Power Supply and output
	F ME36 : RS 485 , complete with 2 connectors: n° 1 for RS 485 connection and 1 for Power Supply + IN/OUT conn
	G ME35 : Profibus DP , complete with 3 connectors : n° 2 for Profibus connection (Male+Female) and n° 1 for Power Supply + IN/OUT conn



ML4-F1-A1A0A (Complete code example for order)

Due to the constant technical development and improvements of its products, the manufacturer reserves the right to make changes and / or modify the information contained in this document without notice. Information contained herein is not binding.